

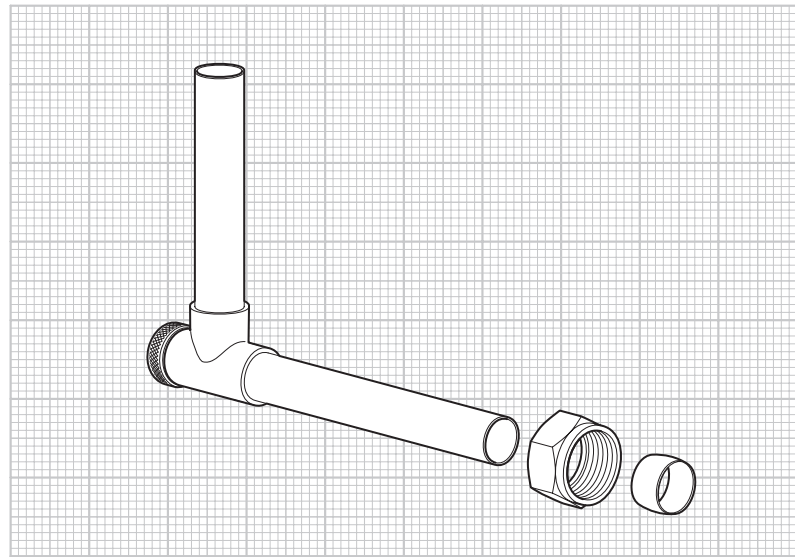
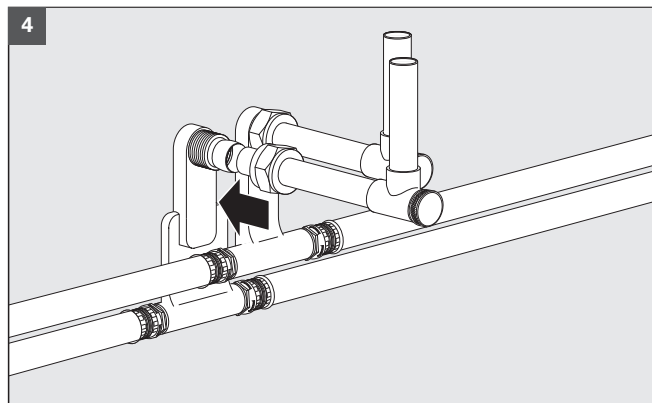
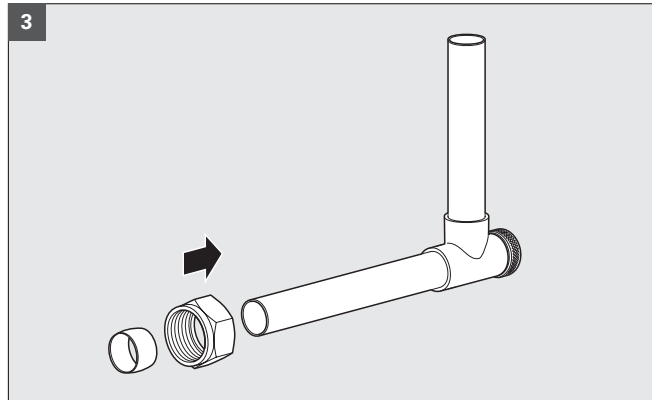
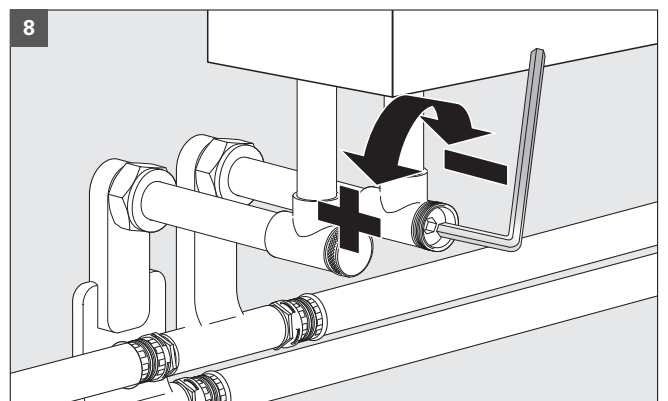
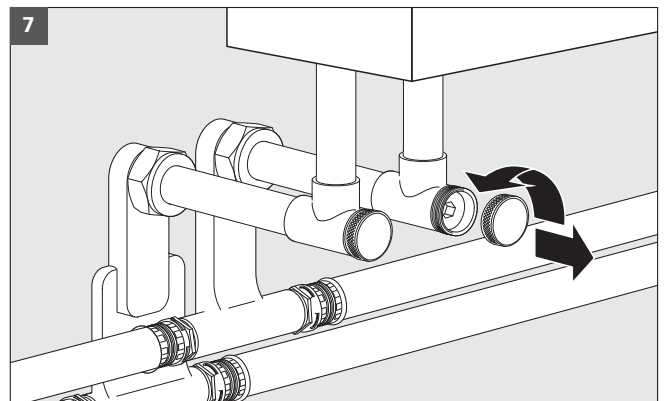


Montage / Mounting

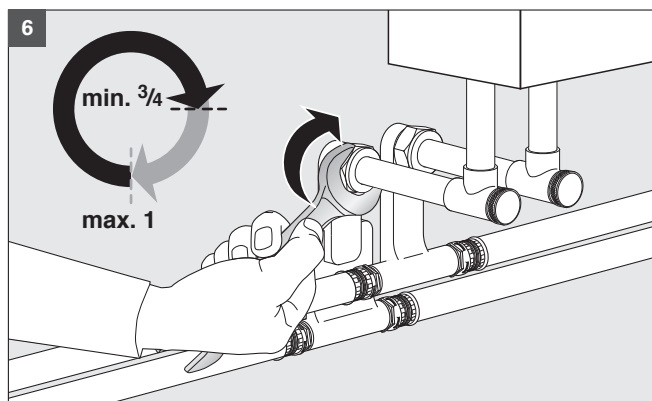

Ausgleichswinkel mit Absperrung
Compensating elbow assembly with shut-off valve

Building Technology
www.fraenkische.com

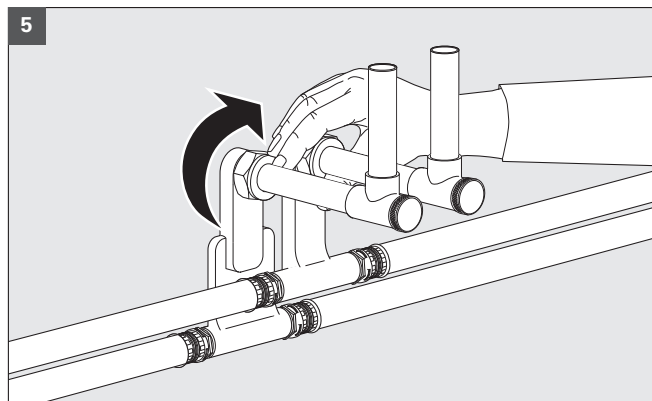

Verarbeitungsrichtlinien / Installation guidelines


Ausgleichswinkel mit Absperrung

- Ventil-Heizkörperanschlüsse und Ausgleichswinkel mit Absperrungen sind für einen max. Dauerbetriebsdruck von 5 bar und eine max. Dauerbetriebstemperatur von 90 °C zu gelassen.
- Für die mitgelieferten Klemmring-Verschraubungen gilt immer: Überwurfmutter handfest anziehen und mit einem passenden Schlüssel/ Werkzeug maximal eine Umdrehung nachziehen.
- Für den Anschluss der Ausgleichswinkel mit Absperrungen sind nur die mitgelieferten Klemmring-Verschraubungen zugelassen. Die Verwendung weichdichtender Verschraubungen ist nicht zugelassen.


Compensating elbow assembly with shut-off valve

- Radiator connections and compensating elbows with shut-off valves are approved for a max. continuous operating pressure of 5 bar and a max. continuous operating temperature of 90 °C.
- The following applies always to the supplied clamping ring fittings: hand tighten the union nut and tighten with a suitable wrench/tool a maximum of one turn.
- For the connection of the compensating elbows with shutoffs, only the supplied compression fittings are permitted. The use of soft-sealing compression fittings is not permitted.

Allgemeine min. – max. Abstände / General distances

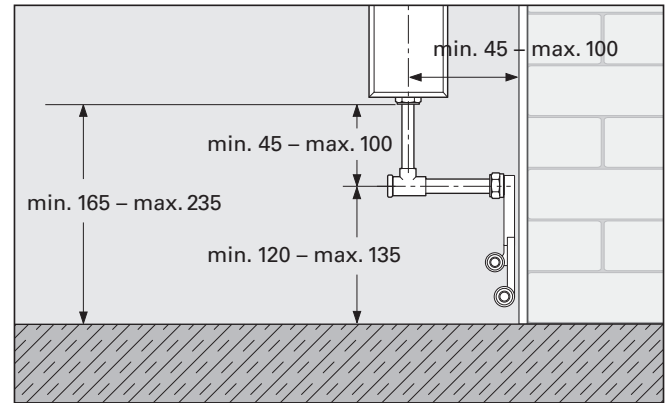

Messen / Measuring

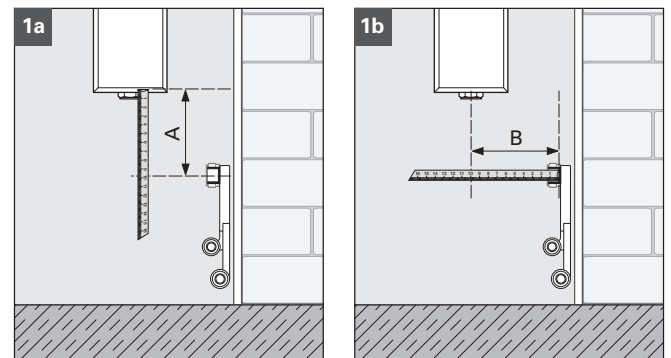

Ablängen, Entgraten / Cutting, deburring

